



# Air Quality For Indoor Pools

*By the PHTA Recreational Water Quality Committee*

**INDOOR SWIMMING POOLS** offer challenges both in maintaining proper water balance and proper sanitization. Volatilization of chlorinated and/or brominated disinfection by-products combined with decreased fresh air exchange can create conditions that may be less than ideal for swimmers and operators in these venues.

This article explores these disinfection by-products (DBP), potential risks associated with them and current practices to help mitigate these potential risks. It is generally accepted that the benefits associated with swimming outweigh any potential risks in indoor venues; however, the positive benefits of swimming should be enhanced by minimizing exposure to DBP.

## ENCLOSED AQUATICS

Indoor recreational water facilities grew from the desire of people in colder climates to continue swimming during the winter months. Since these indoor swimming pools are specifically designed to limit exposure to the outside environment, they have always faced challenges with balancing water chemistry, maintaining heat and humidity levels in the facility as well as providing fresh air exchange around the pool. Since there is

no natural wind in the facility, the indoor air can stagnate without proper ventilation. With typically warmer air in an indoor facility, humidity control can also be a challenge as water evaporates from the pool.

Disinfection in swimming pools, whether indoors or outdoors, requires the use of a primary sanitizer, in many cases chlorine. When chlorine reacts with organic waste materials left behind by bathers, chlorinated by-products can form. These by-products can be volatile and escape from the water into the surrounding air. Being heavier than air, many of these by-products can hover around the surface of the pool and on the pool deck. In outdoor pools, air movement generally disperses many of these by-products, however in indoor facilities, that air movement can be limited thus allowing for greater concentrations to accumulate.

## DISINFECTION BY-PRODUCTS (DBPS) AND PRECURSOR CHEMICALS


Swimmers leave behind a myriad of organics and other chemicals in the water that can react with chlorine to form DBPs. These include such things as urea and creatinine (from sweat and urine), oils and other organics (from personal care products), and other nitrogen-containing compounds. DBPs can take the form of inorganic or organic

chloramines. Inorganic forms are primarily trichloramine ( $\text{NCl}_3$ ), dichloramine ( $\text{NHCl}_2$ ) and monochloramine ( $\text{NH}_2\text{Cl}$ ). Another class of DBPs is typically referred to as trihalomethanes (THMs) of which chloroform ( $\text{CHCl}_3$ ) is a primary concern. A study in Barcelona, Spain (Richardson 2010) identified over 100 DBPs, many of which had not been previously identified in the literature. This is an area open to further research.

## DBPS IN INDOOR SWIMMING POOLS

Several studies have looked for a correlation between the concentration of DBPs in indoor swimming pool water and the concentration of DBPs in indoor air around these pools. At least one study did find significant concentrations of DBPs in both the pool water and the surrounding air, but the correlations between the air concentration and the pool concentration was not strong. However, another study found several factors do correlate the air concentration with the pool water concentration of DBPs. First, is the time of day. Later in the day, more use of the pool and agitation of the water resulted in higher air concentrations of the DBPs. Second, an increase in the number of water changes was associated with a decrease in the air concentration of DBPs. Third, increased ventilation (air changes per hour) resulted in a decrease in DBPs



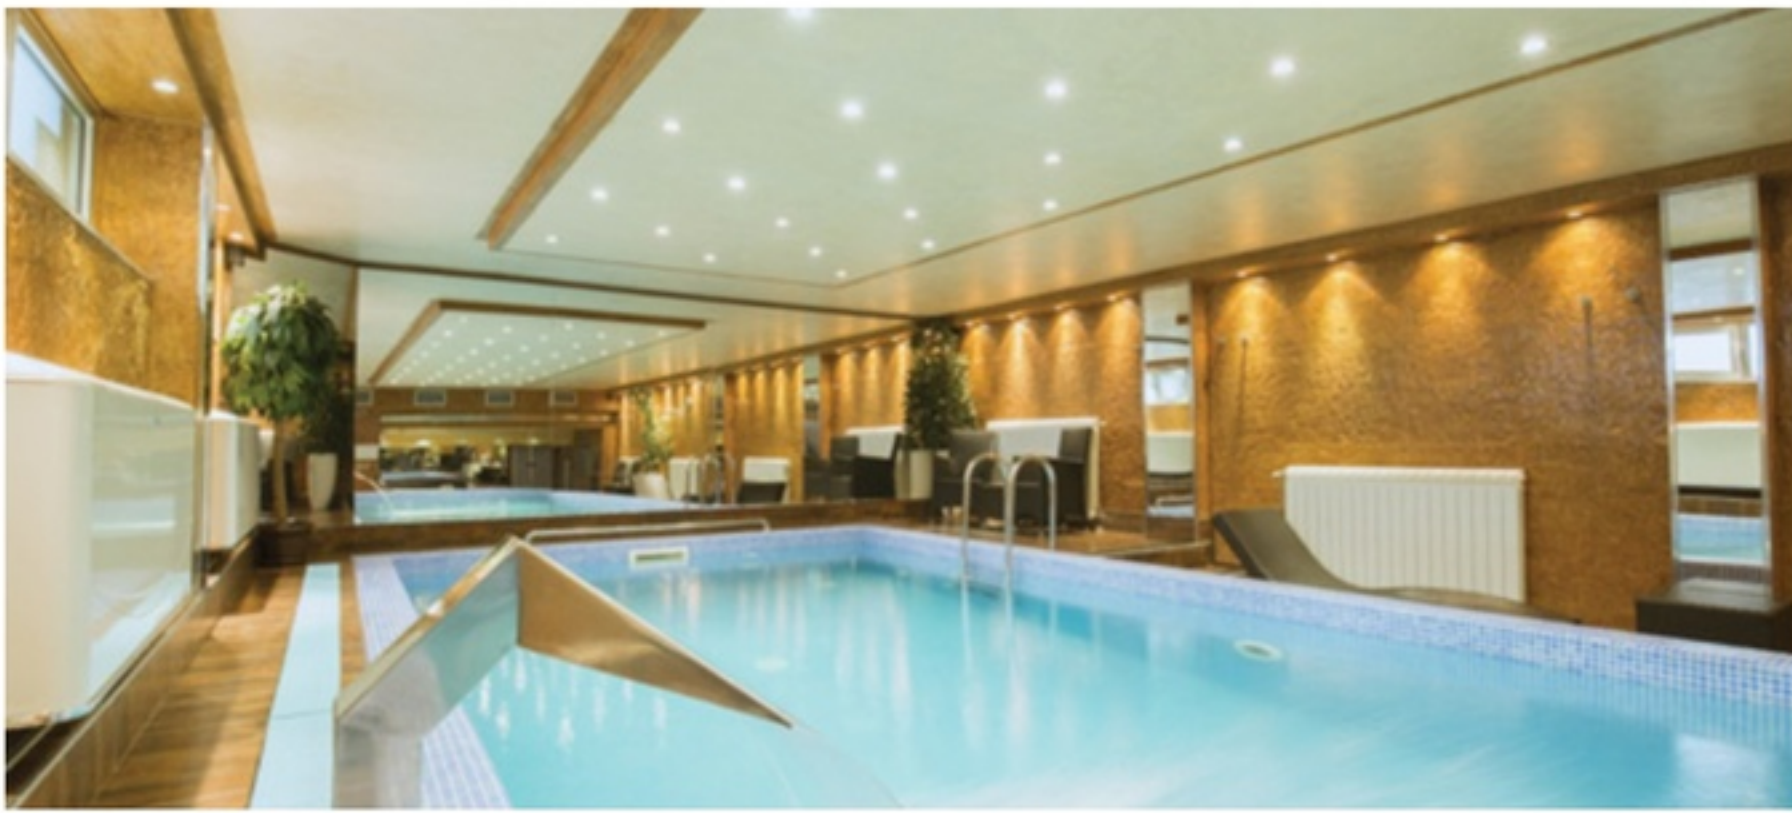

Disinfection in swimming pools, whether indoors or outdoors, requires the use of a primary sanitizer, in many cases chlorine. When chlorine reacts with organic waste materials left behind by bathers, chlorinated by-products can form.

in the air. These studies have identified a wide variety of DBPs in the air surrounding indoor pools. They also indicate the difficulties correlating the concentration of DBPs in indoor pool water to indoor air quality. There is still a lot to learn and further studies are needed.

### HEALTH CONCERNS

Users of indoor swimming venues can sometimes detect a very strong odor of chlorine in the air when they are on the pool deck. This is a sign that there

may be chloramines and/or disinfection by-products building up in the air and/or pool water. It is not a sign of too much free chlorine in the water, it is most likely a sign that there is not enough free chlorine in the water. Chloramines have often been implicated in cases of eye and breathing irritation. In fact, the odor and eye irritation is often the first indication that the water balance and/or ventilation around the pool needs to be corrected.

Beyond the acute eye and respiratory

symptoms, exposure to chloramines and other DBPs has been investigated for potential long-term effects to human health. In laboratory studies, exposure to certain DBPs have been associated with respiratory irritation, developmental toxicity and cancer; however, exposure duration and air concentrations are key factors and association of these effects with swimming pool use continues to be investigated. There have been several studies that examined use of indoor pools and rates of asthma in children, competitive swimmers as well as pool workers. A 2012 published review paper assessed the available epidemiological data and concluded that "the body of evidence indicates that asthma in children is not increased by swimming pool attendance" It was also reported that there is a higher "prevalence of respiratory symptoms including asthma... among swimming pool workers and elite swimmers, although the causality of this association is not clear." Additionally, in summarizing the available data, Villanueva (2012) reported that evidence supports that the use of swimming pools during pregnancy is not associated with increased

**The world's only all natural cyanuric acid reducer**

**The Natural Choice**

**BIO-active**

[www.bioactivenow.com](http://www.bioactivenow.com) | [info@bioactivenow.com](mailto:info@bioactivenow.com)

[www.solarsunrings.com](http://www.solarsunrings.com)  
[info@solarsunrings.com](mailto:info@solarsunrings.com)

**solar sun rings**

Add free heat to your pool with the power of the sun!

**VISIT ATLANTIC CITY BOOTH 3224**

## SALTWATER PROBLEMS?

### Zinc Sacrificial Anodes



**PART# 104-D SPIGOT**  
Fits into any standard 2" Tee



**PART# 104-C**  
1.5" & 2" Retrofit



**PART# 104-D**  
2" Slip x Slip New Install

### HELPS PREVENT

- Plaster Discoloration
- Pool Light Damage & erosion
- Metal Erosion
- Heater Damage

Five years of field testing by a corrosion engineer, guarantees the best protection in the industry.



Call for free catalog!

**POOL TOOL CO.**

805.644.2333

[www.pooltoolco.com](http://www.pooltoolco.com)

Available at your local distributor



risk of adverse reproductive outcomes.

Several additional studies (Villanueva 2015, Kogevinas 2010, Pandics 2018) have continued to investigate the relationships between DBPs exposure and chronic illnesses (including cancer). While there has been continued research in this area, further research is still needed to further elucidate the actual risks based on exposures to DBPs in indoor swimming pools. Therefore, it is prudent to limit exposures to DBPs as much as feasibly possible.


## WAYS TO IMPROVE INDOOR AIR QUALITY AT SWIMMING VENUES

One way to reduce DBPs in swimming pools is to reduce the amounts of the precursor chemicals that are introduced into the pool. Reducing swimmer waste is the first step in improving air quality. Simply showering before entering the pool, reducing the use of the pool as a bathroom, and reducing the amount of personal care products while swimming can greatly cut down the amount of chemicals that can react with chlorine and lead to DBPs. Water replacement is

another means of reducing both DBPs and DBP precursors.

Proper water balance should be always followed and in all areas of the pool. Follow PHTA ANSI Standard-11 for water balance parameters. A paper on pH and its effect on DBP formation (Hansen 2012) found that THM formation was reduced at pH less than 6, however  $\text{NCl}_3$  was an order of magnitude higher than at pH 7.5. Hansen published a subsequent paper in 2013 that showed that the effect of pH on genotoxicity of the DBPs at 6.8 to 7.5 was negligible but greatly increased below that. Maintaining PHTA water balance standards is required.

Appropriate ventilation is important to minimize the accumulation of DBPs around the surface of the pool and pool deck. PHTA ANSI-11 Standard advises to follow ASHRAE Standard 62.1-2004 for management of indoor air quality. Per Standard 62-2004, outdoor air should be supplied with a velocity of 0.48 CFM per square foot of pool and wet deck area. They further advise that for natatoriums there should be 4 to 6 air exchanges per hour and 6 to 8 in the spectator area. ASHRAE also recommends directing

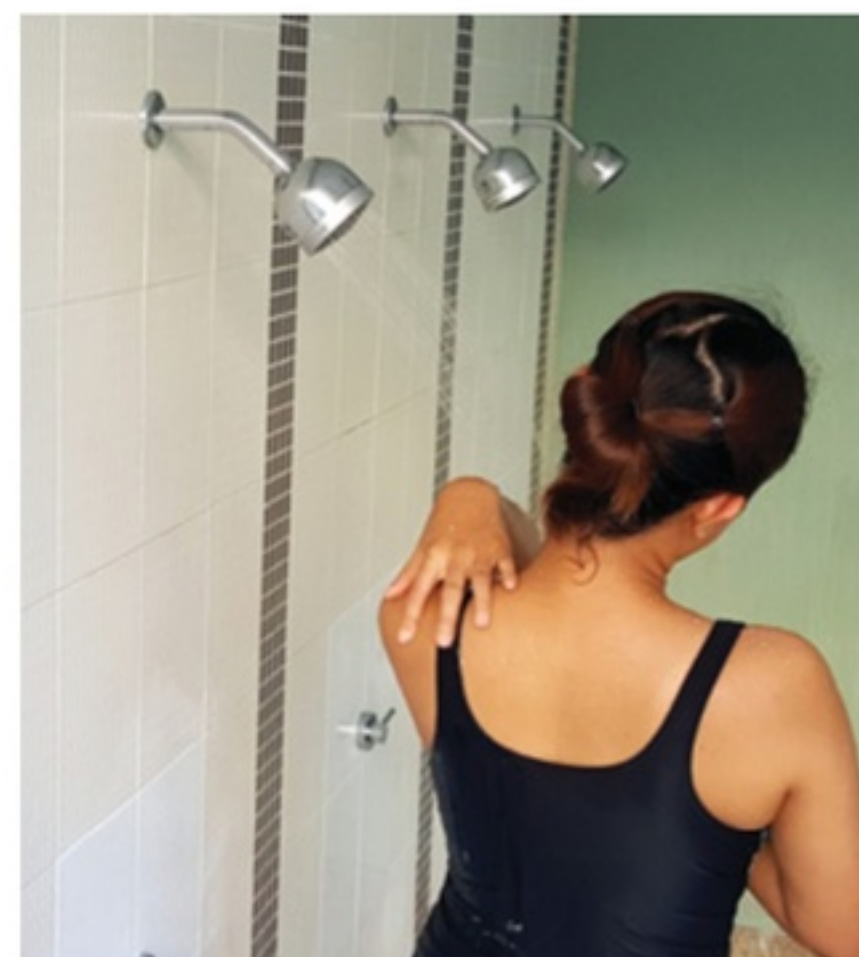

Swimmers leave behind a myriad of organics and other chemicals in the water that can react with chlorine to form DBPs. Simply showering before entering the pool and reducing the amount of personal care products while swimming can greatly cut down the amount of chemicals that can react with chlorine and lead to DBPs.

a portion of the supply air across the surface of the pool to direct chloramines away from the pool. Relative humidity should also be controlled at 40 to 60%. Keeping the natatorium slightly negatively pressured (10 to 15%) is also

## DURABLE AND RELIABLE INDUSTRIAL TOOLS FOR OVER 80 YEARS

**TWINTIER® RB441T**

**WORLD OF CONCRETE BOOTH: W3705**

The MAX RB441T TWINTIER is a battery powered rebar tying tool that can tie #3x#3 up to #7 x #7 rebar in approx. 1/2 second per tie, allowing pool installers to quickly move through the rebar installation process. The one handed operation of the tool helps free up a hand when holding rebar in place, which can especially come in handy when installing pool walls. MAX inventing the world's first rebar tying tool in 1993 and has a history of manufacturing durable and reliable industrial tools for 80 years.

All MAX products are engineered to perform on professional contractors jobsites including pool construction and with MAX's 200 R&D engineers we have continued to improve upon MAX proprietary technology, which led to the invention of the TWINTIER® rebar tying tools. TWINTIER® technology allows the tools to tie 4,000 ties per charge while delivering just the right amount of wire for greater productivity and cost savings. These unique innovative features make the TWINTIER® the most efficient rebar tiers in the industry. Today, MAX manufactures a full line of rebar tying tools that can tie between mesh up to #9 x #10 rebar.

**MAX**

ENGINEERED FOR PERFORMANCE

**80**  
YEAR  
ANNIVERSARY



SCAN HERE TO  
SCHEDULE A DEMO

MAX USA Corp. • 205 Express St. Plainview, NY 11803 • U.S.A. • Phone: (800) 223-4293 • FAX: (516) 741-3272 • [www.maxusacorp.com](http://www.maxusacorp.com)





One study has found significant concentrations of DBPs in both the pool water and the surrounding air, but the correlation between the air concentration and the pool concentration was not strong.

recommended to improve the air quality.

Minimizing the amount of chlorine used can also limit the amount of DBP formation. While 1 to 4 ppm still must be maintained at all times, monitoring these levels and ensuring that too much chlorine is not used can cut back on DBP formation. Limiting times when shocking the pool to allow for air circulation to remove any excessive DBPs from the air can help reduce those chemicals when swimmers are present.

Technology may also contribute to improvements in air quality by reducing DBPs before they leave the pool water; however, the results from these technologies are mixed. A lab study

in 2016 found that ozone can actually increase THM formation upon initial use, however repeated use can decrease total organic matter and THM formation. The study did find that other DBPs could increase with the use of ozone in the lab and does recognize the need for a study in an actual pool. In a study by Li and Blatchley (2008), the ultraviolet (UV) photolysis of monochloramine ( $\text{NH}_2\text{Cl}$ ), dichloramine ( $\text{NHCl}_2$ ), and trichloramine ( $\text{NCl}_3$ ) in aqueous solution was investigated at wavelengths of 222, 254, and 282 nm. All three chloramines can be degraded by UV irradiation, and the quantum yields for these processes are wavelength-dependent. On the basis of the results, a mechanism of photodecay of monochloramine is proposed. In a subsequent study Weng and Blatchley (2012) found that UV caused a decrease in inorganic chloramines, but in the presence of a free chlorine residual, UV caused an increase in organic chloramines such as dichloromethylamine ( $\text{CH}_3\text{NCl}_2$ ), dichloroacetonitrile ( $\text{CNCHCl}_2$ ) and cyanogen chloride ( $\text{CNCl}$ ). They also found that UV increased the free chlorine consumption rate. ~

## REFERENCES

1. Richardson, Susan B. et al., What's in the Pool? A Comprehensive Identification of Disinfection By-products and Assessment of Mutagenicity of Chlorinated and Brominated Swimming Pool Water. *Environmental Health Perspectives* 118:11, 2010.
2. Li, Jing and Blatchley III, Ernest R. Formation of Volatile Disinfection By-Products from Chlorination of Organic-N Precursors in Recreational Water. *Environ. Sci. Tech.* 41:6732-6739. 2007
3. Kanan, A.A., Occurrence and Formation of Disinfection By-Products in Indoor Swimming Pool Water, Clemson University, Graduate Dissertation, July 2018
4. Levesque, Benoit. Et al., Investigation of Air Quality Problems in an Indoor Swimming Pool: A Case Study. *Amm. Occup. Hyg.* Vol. 59, No. 8

1085-1089. 2015.

5. Villanueva, C. and Font-Ribera, L. Health Impact of Disinfection by-products in swimming pools. *Ann Ist Super Sanita* Vol 48. No.4 387-396. 2012
6. Bernard A. et al. Lung Hyperpermeability and Asthma Prevalence in Schoolchildren: Unexpected Associations with the Attendance at Indoor Chlorinated Swimming Pools. *Occup Environ Med*: 60:385-394. 2003
7. Bowen, Anna B. et al. Outbreaks of Short-Incubation Ocular and Respiratory Illness Following Exposure to Indoor Swimming Pools. *Environmental Health Perspectives*. Nov. 28, 2006
8. Nemery, B. et al. Indoor Swimming Pools, Water Chlorination and Respiratory Health. *Eur. Respir. J.* 19: 790-793. 2002
9. Hansen, Kamilla. Et al. Effect of Ozonation of Swimming Pool Water on Formation of Volatile Disinfection By-Products – A Laboratory Study. *Chemical Engineering Journal*. 289:277-285. 2016
10. Lakind, Judy S. et al. The Good, the Bad, and the Volatile: Can We Have Both Healthy Pools and Healthy People? *Environmental Science and Technology*. 44:3205-3210. 2010
11. Hansen, Kamilla. Et al. Optimal pH in Chlorinated Swimming Pools – Balancing Formation of By-Products. *J. Water Health*. 11(3):465-472. 2013
12. Hansen, Kamilla. Et al. Effect of pH on the Formation of Disinfection By-Products in Swimming Pool Water—is Less THM Better? *Water Research*. 46(19):6399-6409. 2012
13. Villanueva, Cristina M. Cordier, Sylvaine. Overview of Disinfection By-Products and Associated Health Effects. *Curr Envir Health Rpt.* 2:107-115. 2015.
14. ANSI/APSP/ICC-11 2019 American National Standard for Water Quality in Public Pools and Spas by the Pool and Hot Tub Alliance, 2019. [www.phta.org](http://www.phta.org)
15. ANSI/ASHRAE Standard 62.1-2016
16. Li, Jing and Blatchley III, Ernest R. UV Photodegradation of Inorganic Chloramines, *Environ. Sci. Technol.* American Chemical Society, 2009, 43, 1, 60–65. Publication Date: November 26, 2008. <https://doi.org/10.1021/es8016304>

### A FEW INDOOR FACTS

- Indoor swimming venues are characterized by having intentionally limited access to the external environment.
- Indoor swimming pools must be maintained to the same standards as their outdoor swimming pool counterparts in terms of water quality and balance.
- Indoor swimming pool water and air quality are tied into the entire facility's air handling and maintenance capabilities. The indoor facility must be considered as a single system.
- There have been numerous studies and regulations concerning disinfection by-products in drinking water, but fewer studies have been conducted for indoor swimming venues.
- Health effects caused by exposure to DBPs in indoor swimming pools and spas continues to be an area of research.

### The PHTA Recreational Water Quality Committee

Jody O'Grady, Taylor Technologies, Inc., Chair  
 Terry Arko, HASA, Inc.  
 Kevin Cox, NSF International  
 Dr. James Egan, LaMotte Company  
 Philip Escobedo, Fluidra  
 Rich Gallo, Pure Swim, Inc.  
 Kenneth Gregory, Pentair Water Quality Systems  
 Dr. Christopher M. Kareis, Axiall, A Westlake Company  
 Dr. Joseph Laurino, Periodic Products, PHTA Board of Directors Liaison  
 Touraj Rowhani, Sigura  
 Terry Snow, TLS Pool Service / Independent Pool and Spa Service  
 Association (IPSSA) Representative  
 Dr. Roy Vore, Vore & Associates LLC  
 John Weber, BioLab, Inc.

Voting Alternates:  
 Jeff Gaulding, BioLab, Inc.  
 Ellen Meyer, Sigura

Consultants:  
 Jana Auringer, Pebble Technology International  
 Beth Hamil, MicroPlasma Ozone Technologies, Inc.  
 David Oxley, Pinellas Aquatic Consultation and Education  
 Dr. Stanley Pickens, Swim-Chem Consulting Services, LLC